



Low Pressure Spring Kit

MEP1600 Series Spring Kit

1506 George Brown Dr.
Marshall, MI 49068
Phone (269) 789-6700
Fax (269) 781-8340
www.marshallexcelsior.com

!WARNING!

Failure to follow these instructions or to properly install and maintain this equipment could result in an explosion and/or fire causing property damage and personal injury or death.

Install, operate and maintain Marshall Excelsior Co. equipment in accordance with federal, state, and local codes and these instructions. The installation in most states must also comply with NFPA standards 58 and 59, and ANSI K61.1


Only personnel trained in the proper procedures, codes, standards and regulations of the LP-Gas should install, maintain and service this equipment. Be sure all instructions are read and understood before installation, operation and maintenance. These instructions must be passed along to the end user of the product.




WARNING: These products contain a chemical known to the State of California to cause cancer and birth defects or reproductive harm

!CAUTION!

Contact or inhalation of liquid propane, and its vapors can cause serious injury or death. LP-gas must be released outdoors in air currents that will insure dispersion to prevent exposure to people and livestock. LP-Gas must be kept far enough from any open flame or other source of ignition to prevent fire or explosion! LP-Gas is heavier than air and will not disperse or evaporate rapidly if released in still air.

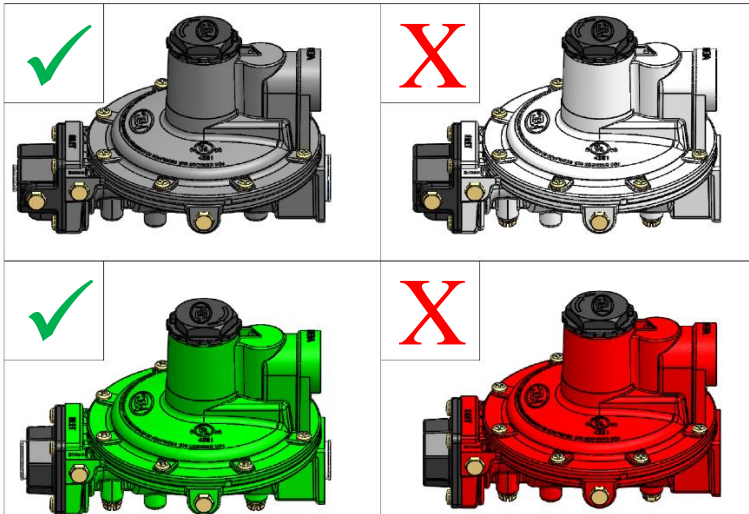


1.

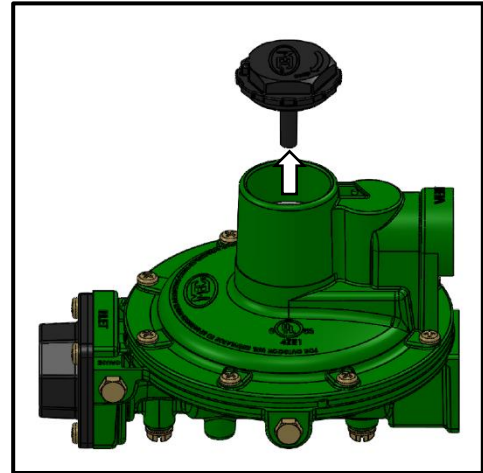


1. Remove Dust Cap from Body.

2.

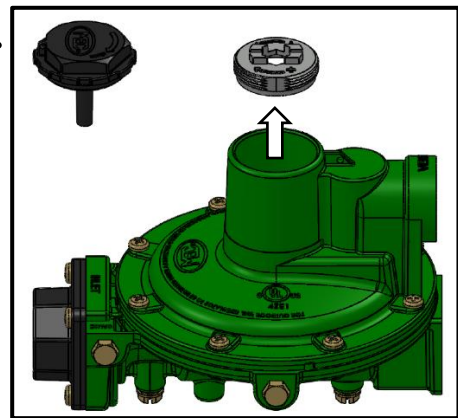

2. Remove Spring Retainer from Body.

3.

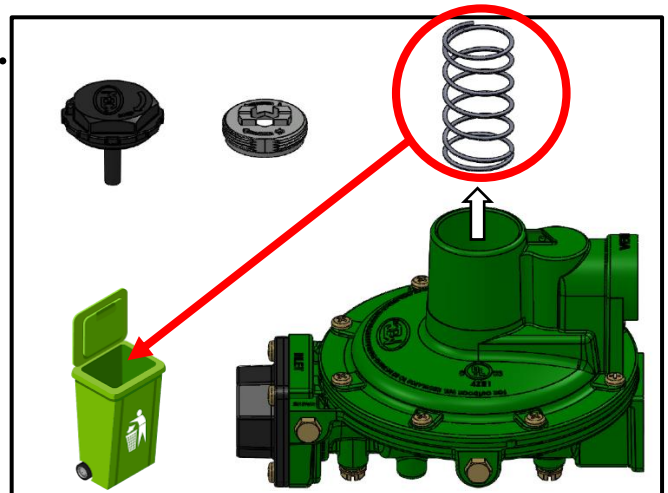


3. Remove Spring from Body and discard.

The contents of this publication are for informational purposes only. While every effort has been made to ensure accuracy, these contents are not to be construed as warranties or guarantees, expressed or implied, regarding the products or services described herein or for their use or applicability. Marshall Excelsior Co. reserves the right to modify or improve the designs or specifications of such products at any time without notice. The MEC™ logo is the trademark of Marshall Excelsior Co.



Low Pressure Spring Kit MEP1600 Series Spring Kit


1506 George Brown Dr.
Marshall, MI 49068
Phone (269) 789-6700
Fax (269) 781-8340
www.marshallexcelsior.com

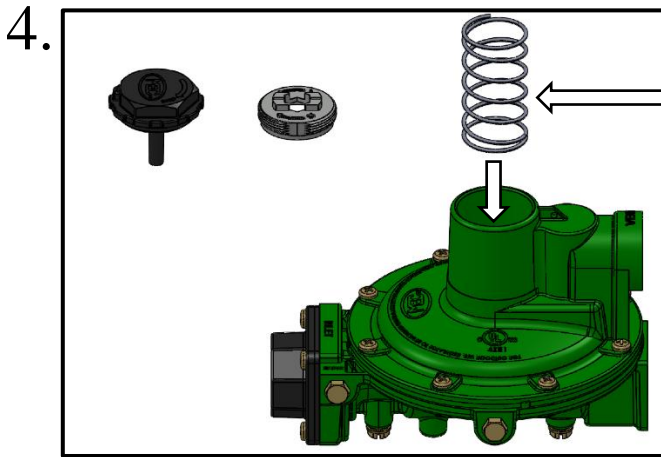


4. Install Spring into Body.

COLOR	OUTLET PRESSURE		P/N
	Inches	mbar	
Red	5-7" WC	12-17	MEGR-31-7
Blue	6-8" WC	15-20	MEGR-31-8
Green	8-12" WC	20-30	MEGR-31-12
Yellow	12-24" WC	30-60	MEGR-31-24


7.

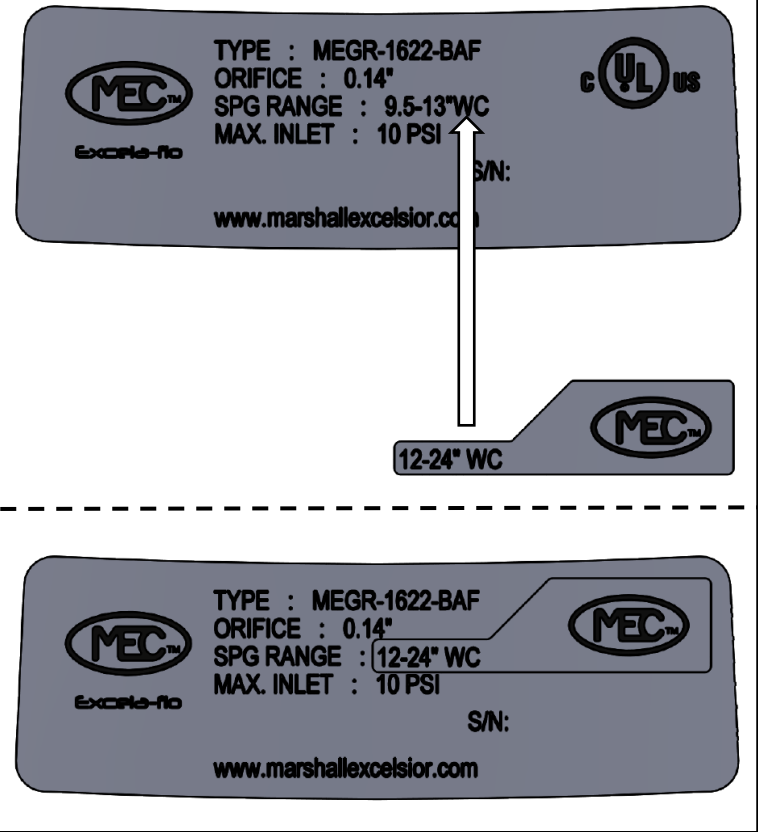

7. Install Spring Range Label onto current Label as shown

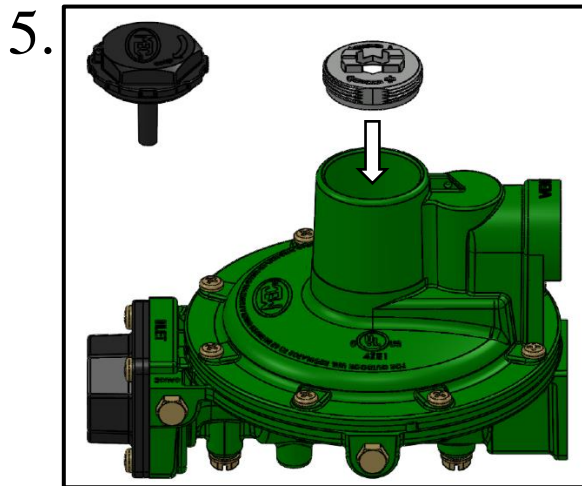

5. Install Spring Retainer into Body.
Set to desired outlet pressure

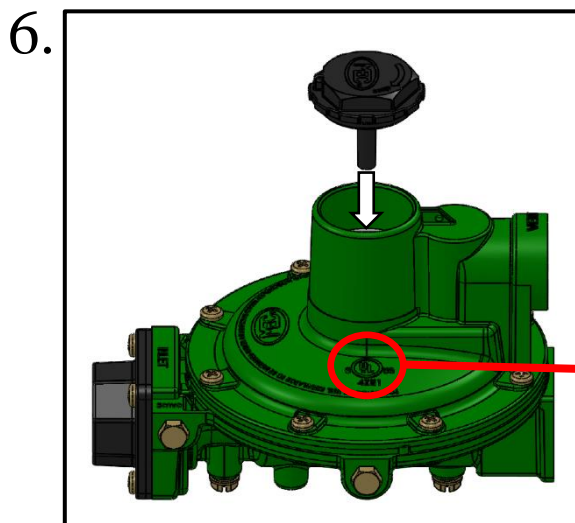

6. Install Dust Cap into Body. Deface UL Logo and Barcode on Body.

The contents of this publication are for informational purposes only. While every effort has been made to ensure accuracy, these contents are not to be construed as warranties or guarantees, expressed or implied, regarding the products or services described herein or for their use or applicability. Marshall Excelsior Co. reserves the right to modify or improve the designs or specifications of such products at any time without notice. The MEC™ logo is the trademark of Marshall Excelsior Co.